

VARko-112 Reactive Power Factor Controller



OPERATING MODES

MANUAL MODE:

This is the manual mode. In this mode, device does not switch the banks by its own. It is accessed by pressing down the set button 3 seconds in Main Menu. In this mode, both mode leds are off, 'EL' text and current display value are continuously interchanged. By pressing down the up button, capacitors are sequentially switched on and by the down button switched off. During the process, the last parameter accessed in the main menu is displayed on the display. By pressing down the set button, system returns to main menu. This mode is used only for testing the system.

LEARNING MODE :


When the device is energized for the first time, it detects the current transformer polarity even if connected in reverse direction and then capacitor switching is done as 'first-in-first-out'. Device starts to calculate each bank's power after every switching. When the device has learned all the capacitor banks' powers, it operates in fully automatically by the device.

When the displayed value has no sign, this means the value is Inductive and when it is negative, "-", signed, this means value is capacitive.

Indicates that compensation is in normal region.


Fully automatic operating mode.

Capacitor Bank LEDs

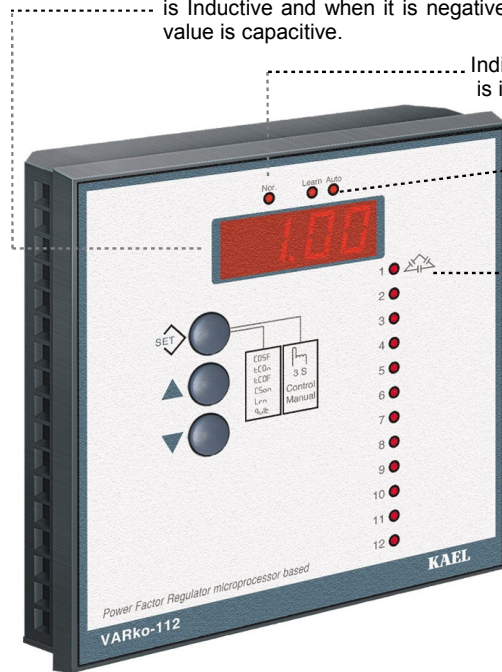

SET UP

► **SET** : The parameters to be set are under this menu. Desired parameter can be accessed by using the direction buttons. On the display, parameter name and numerical value are shown by interchanging. To change the parameter values, press the set button, using the direction buttons reach the desired value. By pressing down the set button, displayed value is stored and the menu is directed to interchange screen. To quit from set menu, advance to 'quit' section and press Set button on it.

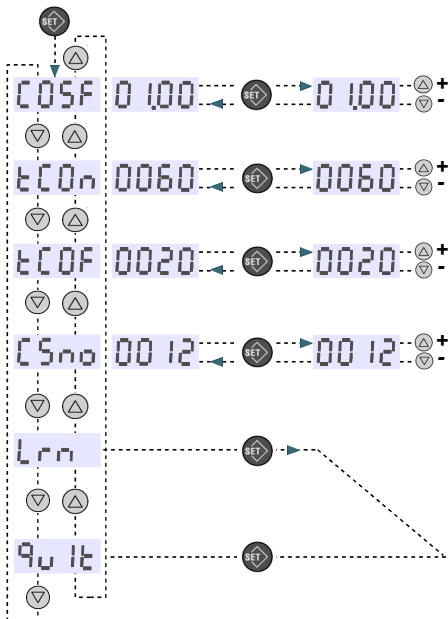

COSφ : It is the section that Cosφ value is set in the range of ± 0.80 – 1.00
Default value is 1.00

tCon : (Max. capacitor bank switch on time) It can be adjusted in the range of 3-120 seconds.
Default value is 15 sec.

tCOF : (Max. capacitor bank switch off time) It can be adjusted in the range of 10-60 secs.
Default value is 10 sec.

CSno : It is the section that used to set used capacitor step number. Capacitor step number is set in the range of 3-8/12. Parameter name and capacitor step number are shown by interchanging on the screen.
Default value is 12

Lrn : When the new capacitor/s are connected the system, you should start to learning mode. Device starts to calculate each bank's power after every switching. When the device has learned all the capacitor banks' powers, it operates in fully automatically by the device.

quit : Pressing down the set button, device returns to main menu.

Connection Diagram

